
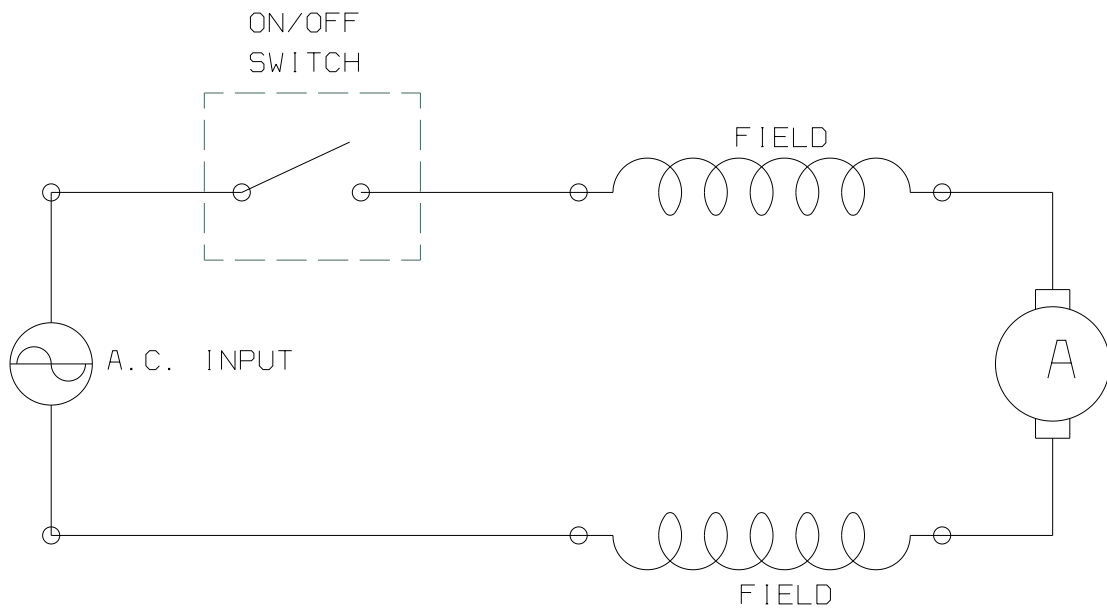


NOTES:

2 ENSURE CABLE IS FIRMLY SEATED IN THE HOUSING LEAD TRAP

3 BRUSH SHUNT MUST BE INSTALLED OUTSIDE THE BROWN OR BLACK LEAD TO SWITCH

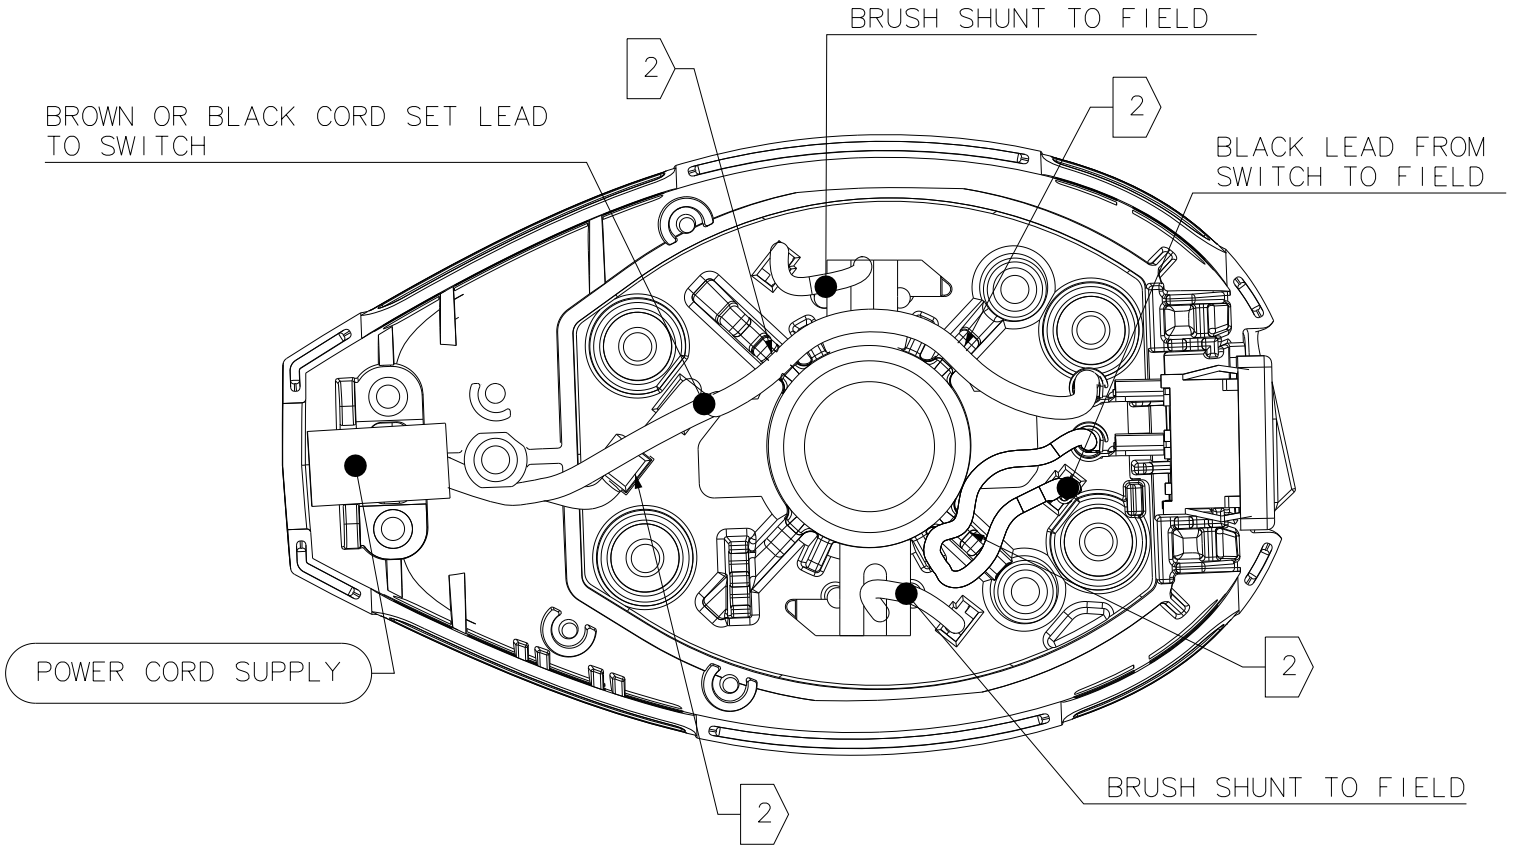

CONNECTION DIAGRAM N119039
Black & Decker (U.S.) Inc.
Product Service Division
Towson, Maryland (Jun11-TS)